


Ссор	YRIGHT by MEIKO		
1.0	machine connection: drain connection hose, DN 22		
	hose fitted as odour trap in interior of machine		
1.1	drain (max. 700 mm above finished floor level), DN 50		
2.0	Machine connection: fresh water supply, G 3/4"		
2.2	Soft cold water 10°C, DN 15, G 3/4 a		
	max. 0,54 mmol/l CaCO₃ (max. 3°dH)		
	Flow rate: 5.0 l/min		
	Minimum flow pressure: 60 kPa / 0.6 bar in front of solenoid valve		
	Maximum pressure: 500 kPa / 5.0 bar stopcock and fine screen ≤ 25 µm		
20	Machine connection: electrical connection cable $5G - 6mm^2$		
3.0			
3.1	electricity supply to the machine: 3N PE 400V ~ 50Hz		
	nominal current / - capacity: 25.4 A / 14.7 kW		
	Voltage equalising cable		
0.0	The master switch must be provided on site		
6.0	Heat load of warewash area		
	The values apply for the following room conditions: Room temperature 22 °C, rel. humidity 55 %		
	Recommended suction area according to German EN 16282 or any local regulations have to be observed to determine ventilation of wash areas The total heat load includes 6.1		
6.1	Heat load of the machine in normal washing operation:		
0.1	for 15 programme cycles/h		
	total 4.5 kW, perceptible 3.0 kW, latent 1.5 kW		
	For the total space load, all other space loads must be considered. The space ventilation must be designed in accordance with EN 16282.		
all ca	bles, pipes etc leaving machine 1,4 m		
Mac	chine Equipment		
Tank	/ boiler locked		
(A) Ei	Entry height		
Final	Final rinse dosing unit with suction lance (blue connector)		
Back	wall cladding		

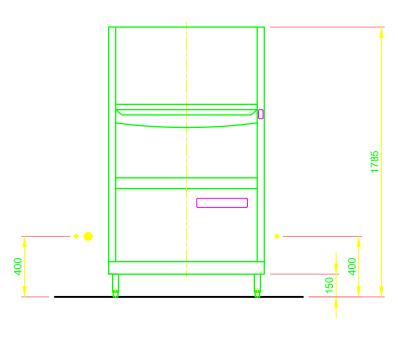

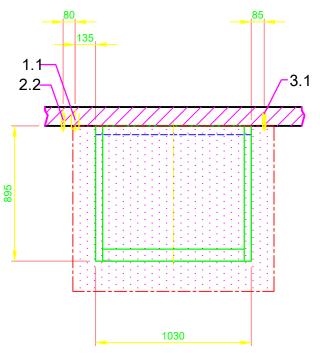

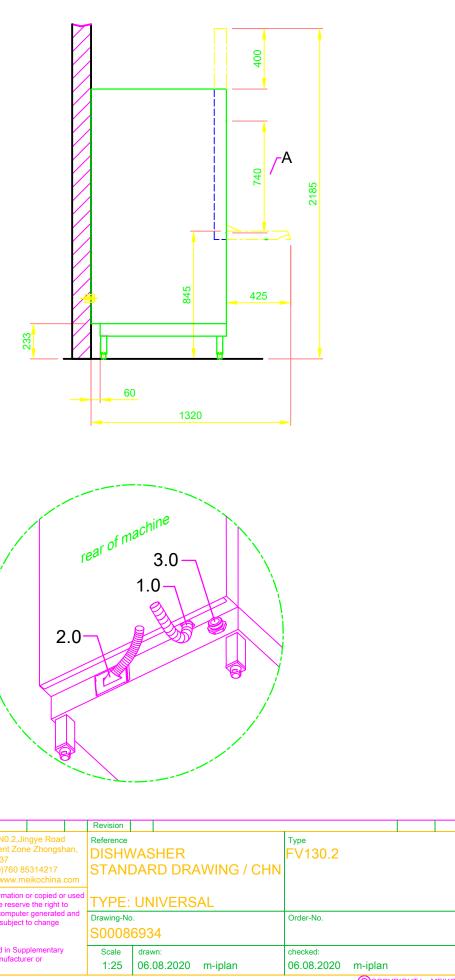

1				Rev	
	Torch Hig Guangdo MELKO	ash-Up Technologies LTD. N0.2, Ji h Tech Industrial Development Zor ng,P.R.C, Postal code: 528437 0)760 85317591 Fax:+86 (0)760 8 http://www.meiko.de http://www.m	e Zhongshan, 5314217	Ref DI S1	
This drawing may not be neither passed to third parties for their information or copied or for competitive purposes without our consent. All rights reserved. We reserve the right t					
	make changes resulting from technical progress. This drawing was computer generated and is not subject to the checking and any release process; it is also not subject to change				
	management. Please note:		SC		
		a document is only valid in conjunction with the conditions defined in Supplementary et "Important Information". These can be requested from the manufacturer or inloaded from the Partnernet.			

EN



COPYRIGHT by MEIKO